



DRAWING TITLE
SCHOOL TYPE
KEY LEARNING / SUPPORT AREA

L.P.G Enclosure
Primary & Secondary
PS611 Services
HS611 Services

LOCATION


PS611.01 Main Switchroom
Cupboard
PS611.02 Distribution Board
Cupboard
PS611.11 Services Zone
HS611.02 Main Switchroom
Cupboard
HS611.03 Distribution Board
Cupboard
HS611.11 Services Zone

SPECIFICATION REF

Fences and External Walls

NOTES

Guide only; do not use as a construction detail

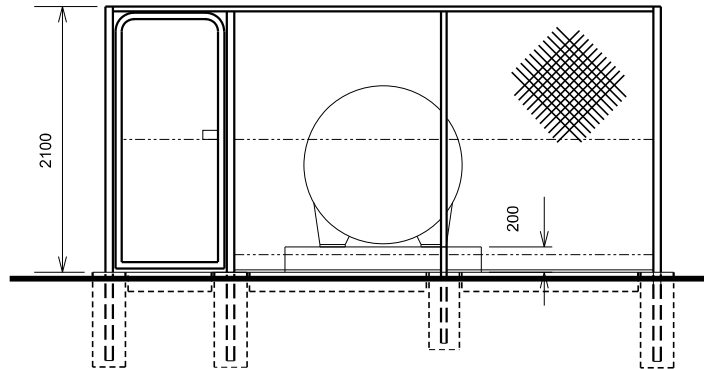


END ELEVATION


STANDARD L.P. GAS STORAGE TANKS
WITHIN GOVERNMENT CONTRACT (REFERENCE GUIDE)

NOM. TANK CAPACITY	INTERNAL DIAMETER	LENGTH	CLEARANCES FROM FENCE	BUILDS.
190 kg	770	1200	NIL	NIL
1.0 kl	770	2770	2000	3000
2.5 kl	1250	2400	3500	5000
2x2.5 kl.			5000	8000
4.5 kl	1250	3980	3500	5000
2x4.5 kl.			5000	8000
6.7 kl	1250	5160	4000	6000
2x6.7 kl.			6000	10000
7.5 kl	1250	6600	4000	6000
2x7.5 kl.			6000	10000

FOR CLARIFICATION & SITING OF L.P.G. TANKS SEE L.P.GAS CODE A.S.1596 & MECHANICAL/HYDRAULIC ENGINEERS. TREES NOT TO OVERHANG ENCLOSURE AND NOTHING TO BE STORED WITHIN ENCLOSURE.

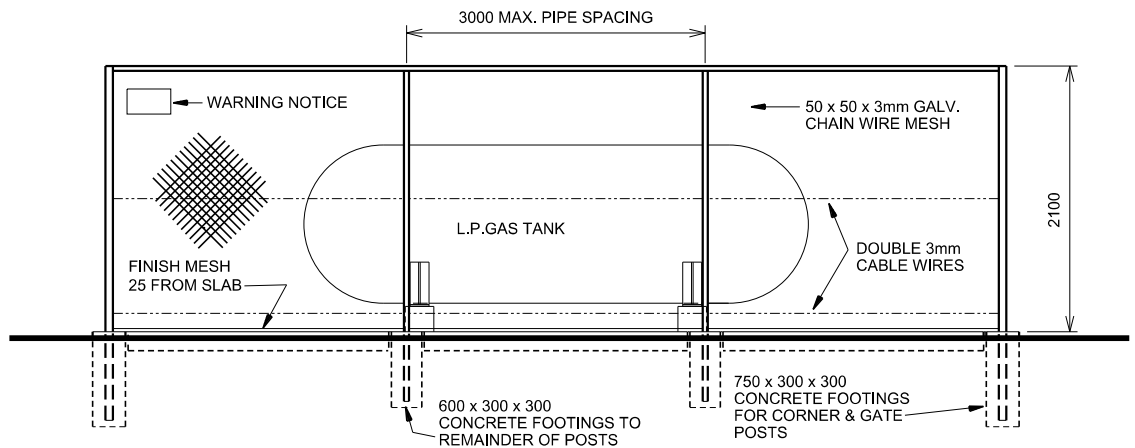

ELEVATION

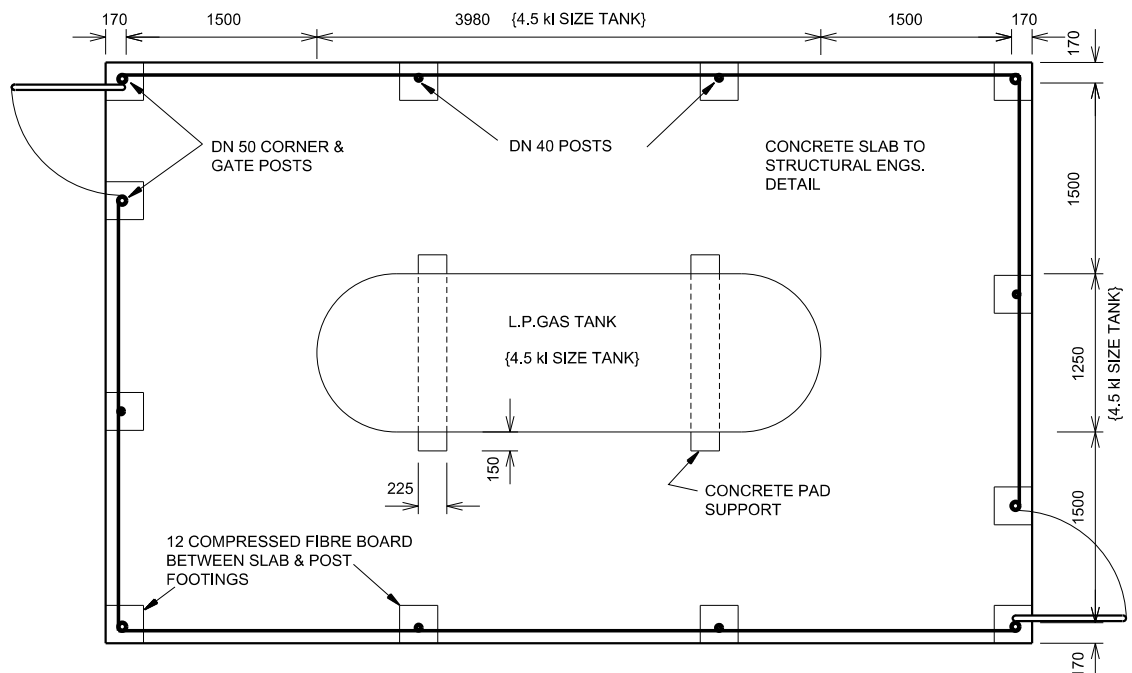

PLAN